

MONARCH Dry Chemical Hazardous Material Storage Building Fire Suppression System

General


A growing number of local, state, and federal ordinances concerned with the storage and containment of hazardous materials has led to the development of special application prefabricated storage buildings. These secured structures are intended to segregate hazardous materials from a main facility where occupancy or the lack of proper spill containment can result in accidental injury or ground contamination. These relocatable structures can be designed in a variety of sizes with functional flexibility to suit a broad range of applicable codes. The need for fire protection in these structures is referenced in several major guidelines, including the Uniform Building Code, Uniform Fire Code, National Fire Protection Association Standard No. 30 – “Flammable and Combustible Liquids Code,” and the Occupational Safety and Health Act.

The PYRO-CHEM MONARCH pre-engineered Industrial Fire Suppression System offers a cost effective solution for most hazardous material storage buildings. The PYRO-CHEM MONARCH dry chemical extinguishing agents are appropriate for Class A, B or C fires. A careful hazard survey should be conducted to properly define the type of fire to be extinguished. Resident material in the protected area must be considered in addition to the stored flammable/combustible liquids. The PYRO-CHEM MONARCH system utilizes a “total flooding” protection concept as defined by NFPA Standard No. 17 – “Dry Chemical Extinguishing Systems.” Underwriters Laboratories and Factory Mutual provide pre-engineered system application parameters allowing the flexibility to protect a variety of hazardous material storage building layouts with confidence.

System Operation

Hazardous material storage building fire protection is a special application of the PYRO-CHEM MONARCH Industrial Fire Suppression System. It provides a highly reliable response with versatility of automatic or manual activation.

A modular concept of protection is used. A nozzle, with a prescribed area of protection positioned according to pre-engineered placement parameters, protects a modular area of hazard. Sets of nozzles supplied by a dedicated cylinder containing dry chemical extinguishing agent and piped in an approved pattern consistent with the application coverage are utilized. Mechanical or electrical fixed temperature detectors are positioned strategically within the protected area to monitor ambient temperature and initiate an output should the rated temperature be exceeded. The detector input is “sensed” at the control head. The control head responds by discharging the system by pneumatically depressing the stored agent cylinder valve. A manual means of activating the system is also provided.

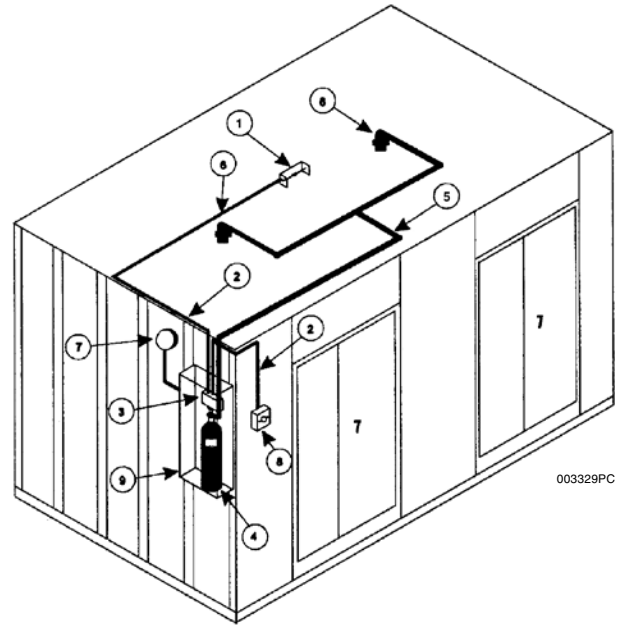

003329PC

Typical Hazardous Material Storage Building Protection

1. Fixed temperature mechanical or thermal detectors
2. Electrical conduit protecting stainless steel cable
3. Model MCH Control Head
4. Model PCI-Series Agent Storage Cylinders
5. Fixed agent distribution piping
6. Extinguishing Agent Discharge Nozzles
7. Alarm Bell
8. Model RPS-M Remote Mechanical Pull Station
9. Enclosure

Expanded capability is available to provide remote manual activation, auxiliary electrical outputs and/or audible alarms. This optional equipment will enhance the basic system functions and be applicable when designing custom configurations to suit a particular customer's needs and/or comply with local codes.

Suggested Architect's Specifications

1. General

1.1 – The fire extinguishing system shall be the stored pressure dry chemical pre-engineered fixed nozzle type manufactured by Pyro-Chem. The system shall provide for the protection of the hazardous material storage building(s) described in drawing _____ . (Note drawing number and revision.)

1.2 – The system shall be capable of automatic and manual actuation. It shall be U.L. Listed and installed in conformance with National Fire Protection Association Standard No. 17, “Dry Chemical Extinguishing Systems” and No. 30, “Flammable and Combustible Liquids Code,” and comply with all local and/or state Codes and Standards.

1.3 – The system shall be designed for operation at ambient temperatures from –20 °F to 120 °F (–29 °C to 49 °C).

Suggested Architect's Specifications (Continued)

2. Cylinder and Agent

2.1 – Agent. The system shall use PYRO-CHEM monoammonium phosphate-based or sodium bicarbonate-based dry chemical agent.

2.2 – Cylinders. Steel cylinders manufactured, tested, and marked in accordance with DOT 4B 350 or DOT 4B 500 shall be used to store the extinguishing agent. Cylinder Models PCI-15ABC shall be used with extinguishing agent fill weight of 12.5 lb. Cylinder Models PCI-17ABC shall be used with extinguishing agent fill weight of 17 lb. Cylinder Models PCI-25sABC/BC shall be used with extinguishing agent fill weight of 25 lb. Cylinder Models PCI-35ABC shall be used with extinguishing agent fill weight of 35 lb. Cylinder Models PCI-50sABC/BC shall be used with extinguishing agent fill weight of 50 lb. Cylinder Models PCI-70ABC shall be used with extinguishing agent fill weight of 70 lb. All models are charged with dry nitrogen to 350 psig at 70 °F.

2.3 – Cylinder valve. A pressure sealed poppet-type valve having a brass body, stainless steel stem with rubber seat washer, fusible safety relief assembly, and pressure gage shall be used on all agent cylinders.

2.4 – Cylinder bracketing. Cylinders shall be mounted vertically. The cylinders shall be secured by use of a steel mounting bracket affixed to a rigid object capable of supporting the weight of the filled cylinder and the concussion of cylinder discharge.

3. Actuation Controls

3.1 – Control Head. The system control head shall include a Model MCH or ECH-Series Control Head. The control head shall be mounted directly on the valve of the agent cylinder (for single cylinder systems), in a Model MB-P2 control head mounting bracket (for actuating up to five centrally located agent cylinders) or directly on the valve of a pneumatic actuating cylinder. A carbon dioxide pilot cartridge that complies with MIL-C0601G shall be used as an integral component of the control head. Control head status shall be visually indicated by a SET/FIRED indicator.

3.2 – Detection. The ambient temperature of the hazard area shall be monitored by fixed temperature mechanical or electrical thermal detectors. When the temperature of the hazard area exceeds the rating of any detector, the detector shall a) release tension in a cable connected to the control head, causing control head activation (for mechanical detectors), or b) close a normally open switch element within the detector, sending a signal to the control head which energizes a solenoid in the control head, exercising the control head (for electrical detectors).

3.3 – Pneumatic actuation. For systems requiring more than five agent cylinders, the system shall have a PAC-Series Pneumatic Actuating Cylinder whose valve opens upon activation of the control head. The valve shall release nitrogen from the PAC cylinder into the pneumatic pipe and tubing network. This

nitrogen shall depress a piston above the valve stem in each agent cylinder, opening each agent cylinder valve and releasing the pressurized agent.

3.4 – Manual actuation. The system shall have mechanical manual actuation capability requiring no electrical power. This is accomplished locally by twisting the handle on the cover of the MCH or ECH Control Head, or remotely by means of a Model RPS-M remote mechanical pull station.

3.5 – Auxiliary output. The system shall provide for the shut off of power to equipment within the hazard and to ventilation systems in the event of system actuation. This is accomplished by means of dry contacts on a Model MS-SPDT or MS-DPDT miniature switch installed in the control head. The miniature switch may also be used for auxiliary functions such as audible alarms or alarm signaling.

3.6 – Supervision. A Model SM Series Solenoid Monitor shall be used to supervise the integrity of all electrical actuation circuits, whether automatic or manual.

3.7 – Protection. A weatherproof enclosure designed and installed in conformance with NFPA 17 shall be used to protect the control head and agent cylinder when mounted in an exterior location.

4. Distribution Nozzles

4.1 – Nozzles. The system shall utilize PYRO-CHEM discharge nozzles to distribute agent throughout the hazard area. The model, quantity, location, and orientation of nozzles shall be in accordance with PYRO-CHEM Industrial Fire Suppression System Technical Manual (Part No. 551228).

4.2 – Nozzle covers. All nozzles shall be installed with nozzle covers to prevent foreign matter from clogging the discharge nozzles.

5. Pipe and Fittings

5.1 – Pipe. All pipe shall be Schedule 40 black, galvanized, chrome plated or stainless steel pipe in compliance with NFPA 17. All pipe ends shall be thoroughly reamed after cutting, and all oil, chips, and debris shall be removed prior to nozzle installation.


5.2 – Fittings. Standard weight malleable, galvanized, chrome plated or stainless steel fittings shall be used.

5.3 – Size. All system pipe and fittings will be sized in accordance with the system Technical Manual. No substitutions are allowed.

5.4 – Joints. No joint sealant shall be used in the discharge piping. Exception: Teflon tape may be used to ensure a snug fit.

5.5 – Straps. All system discharge pipe shall be securely fastened by means of pipe hangers and/or pipe straps. UL Listed pipe hangers shall be used.

5.6 – Union. A union shall be installed in the discharge piping conveniently close to the cylinder valve to permit disconnection for inspection and service.

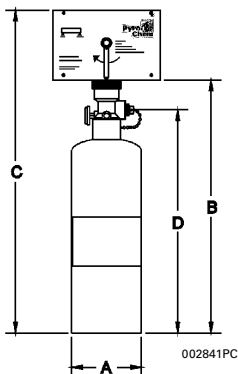

MODEL NO.	A	B	C	D	WEIGHT	MOUNTING BRACKET USED
PCI-15ABC	6.00	21.44	27.19	18.69	30 lb	MB-15
PCI-17ABC	8.00	24.81	30.56	22.06	50 lb	MB-15
PCI-25sABC/BC	8.00	24.81	30.56	22.06	58 lb	MB-15
PCI-35ABC	10.00	29.94	35.69	27.18	71 lb	MB-1
PCI-50sABC/BC	10.00	29.94	35.69	27.18	86 lb	MB-1
PCI-70ABC	12.00	35.31	41.06	32.56	130 lb	MB-1
ALL DIMENSIONS IN INCHES						